

GREE

making better air conditioners

TECHNICAL SALES GUIDE

Capacity Range: 8~45kW

T1/R410a/50Hz



19 ~ 45kW



8~15kW

MINI CHILLER



The photos of products on the cover are for reference only, the actual appearance of certain product may be different.

CONTENTS

1. MODELS LIST	3
2. NOMENCLATURE	4
3. FEATURES	5
4. PRODUCT DATA	7
5. PERFORMANCE CORRECTION	9
6. ANTIFREEZE	11
7. ELECTRICAL DATA	11
8. FIELD WIRING DIAGRAM	12
9. WIRING DIAGRAM	14
10. INSTALLATION	16
11 ACCESSORIES.....	25

1 MODELS LIST

1.1 Split Type

Nominal Capacity	Model		Power Supply
kW	Refrigerant	Model Name	Ph, V, Hz
8	R410A	HLR8WZNa-M	3, 380, 50
10		HLR10WZNa-M	3, 380, 50
12.5		HLR12.5WZNa-M	3, 380, 50
15		HLR15WZNa-M	3, 380, 50

1.2 Integral Type

Nominal Capacity	Model		Power Supply
kW	Refrigerant	Model Name	Ph, V, Hz
19	R410A	HLR19SNa-M	3, 380, 50
25		HLR25SNa-M	3, 380, 50
35		HLR35SNa-M	3, 380, 50
45		HLR45SNa-M	3, 380, 50

2 NOMENCLATURE

2.1 Split Type

HL R 15 W Z Na — M (O)

Model	Model number description	Options
HL	Mini chiller	
R	Product type	R=Heat pump
15	Nominal cooling capacity	8=8kW=27300Btu/h 10=10kW=34120Btu/h 12.5=12.5kW=42650Btu/h 15=15kW=51180 Btu/h
W	Structure feature	Default= vertical type W= horizontal type
Z	Product configuration	Z= combination
Na	Refrigerant	Na=R410A
M	Voltage	M=3Ph , 380V~415v, 50Hz
O	Indoor and outdoor unit code	I = indoor unit O=outdoor unit

2.2 Integral Type

HL R 35 S Na — M

Model	Model number description	Options
HL	Mini chiller	
R	Product type	R=Heat pump
35	Nominal cooling capacity	19 =19kW=64828Btu/h 25 =25kW=85300Btu/h 35 =35kW=119420Btu/h 45 =45kW=153540 Btu/h
S	Product configuration	S =twin circuits
Na	Refrigerant	Na=R410A
M	Voltage	M=3Ph , 380V~415v, 50Hz

3 FEATURES

GREE Mini Chiller which has the capacity from 27300 Btu/h to 153540 Btu/h is a kind of small central air conditioning unit.

GREE Mini Chiller can offer the perfect combination of high quality, energy saving and low cost. These units are CE certified and manufactured under strict quality control.

GREE Mini Chiller can be widely used in high-grade flats, combination buildings, high-grade townhouse, and unitary office, restaurants, department stores, entertaining places and other places that have special air conditioning requirements. The units can work normally in heating mode when the outdoor temperature drops to even -15C.

Use of new refrigerant friendly to earth

GREE Mini Chiller uses the new refrigerant R410A which contains hydro-fluorocarbon (HFC) and of which ODP is zero. This means the new refrigerant is more friendly to the global environment in comparison with the conventional one (HCFC22) of which ODP is 0.055.

Careful safety measures

If the GREE Mini Chillers are out of order, their operation is automatically stopped by various safety and protective devices listed below before trouble occurs.

- ◆ Electric system
Over-current relay, compressor thermal protector.
- ◆ Refrigerant system
High pressure switch, low pressure switch, safety valve.
- ◆ Water system
Water flow switch, auto water fill valve, auto exhaust valve.

Energy-saving and High efficiency

The compressor with High efficiency and reliable quality and the most optimum refrigerant system make the GREE Mini Chiller energy-saving and high efficiency .

High reliability

Heat transfer media of this unit is water and with no distance limitation, only considering enough water pump lift can realize long-distance heating and cooling.

Low noise

High-quality low-noise fan, water pump and varieties of silencing technologies are used for large reduction of running noise, keeping your rooms away from noise pollution.

Excellent Control System

It is available to conduct on or off control to chiller in rooms, that is, when order of turning on from only a single room, chiller on; when all rooms send unit off order, chiller off; general control spot can be set at living room to conduct prior control to unit.



Economic Installation And Convenient Usage

Water pump, expansion vessel, automatic water replenishing valve and safety valve are integrated. It's unnecessary to install expansion vessel and just directly connect the water pipe ,which saves more installation costs.



Superior Anti-freeze (Split Type)

Indoor unit could install in the house to protect the tube-in-tube-exchanger from being frozen.



Sloping air-out (Integral Type)

Prevent seasonal wind and installation position from affecting cooling/heating result. It is especially suitable for installation limited by height or distance between buildings.



Versatile Functions

The controller has versatile functions that is not only supplying the basic functions such as Power on/off, mode setting, temperature & malfunction displaying, but also supporting water temperature setting and physical parameter checking(including inlet/outlet water temperature, outdoor ambient temperature, antifreeze temperature, defrost temperature and exhaust temperature)

4 PRODUCT DATA

4.1 Split Type

Models			HLR_WZN _a -M			
			8	10	12.5	15
Nominal Capacity	Cooling	kW	8	10	12.5	15
		Btu/h	27300	34120	42650	51180
		RT	2.3	2.9	3.6	4.3
	Heating	kW	9	11	13.5	16
		Btu/h	30700	37550	46100	54600
		RT	2.6	3.1	3.9	4.6
Power Consumption	Cooling	kW	3.3	4.4	5.2	5.6
	Heating	kW	3.2	4.2	5.0	5.5
Power Supply	V, ph, Hz	380~415, 3, 50				
Safeties			High/low pressure switch, compressor thermal protection, over current protection, lose of phase/anti-phase protection, antifreeze protection, water flow switch			
Refrigerant	Type		R410a			
	Charge	kg	3.1	3.55	3.6	5.5
Compressor	Type		scroll	scroll	scroll	scroll
	NO.		1	1	1	1
Condenser Evaporator	Heat Exchanger			Tube-in-Tube		
	Water In/Out Pipe Diameter	Inch	1	1	1	1
Condenser	Heat Exchanger			Aluminum fin-copper tube		
	Fan Motor Power Input	kW	0.2	0.14	0.14	0.2
Pump	Water Flow		L/s	0.36	0.50	0.56
	GPM	5.78	7.94	8.83	11.48	
	Delivery Lift		m	18	18	18
	Power Input		W	550	550	550
Expansion vessel Tankage			L	5	5	5
Indoor Unit	Unit / Packing Dimension	Height	mm	288/385	288/385	288/385
		Width	mm	1100/1285	1100/1285	1100/1285
	Net/Gross Weight	Depth	mm	450/682	450/682	450/682
		kg	kg	84/96	84/96	84/96
Outdoor Unit	Unit / Packing Dimension	Height	mm	840/850	1250/1280	1250/1280
		Width	mm	1018/1100	1032/1100	1032/1100
	Net/Gross Weight	Depth	mm	412/450	412/450	412/450
		kg	kg	90/100	112/123	115/125

4.2 Integral Type

Models			HLR_SNα-M			
			19	25	35	45
Nominal Capacity	Cooling	kW	19	25	35	45
		Btu/h	64828	85300	119420	153540
	Heating	RT	5.4	7.1	10	13
		kW	21	27	37	47
Power Consumption	Cooling	Btu/h	71650	92124	126250	160360
	Heating	RT	6	7.7	10.6	13.5
Power Supply	V, ph, Hz		380~415, 3, 50			
Safeties			High/low pressure switch, compressor thermal protection, over current protection, lose of phase/anti-phase protection, antifreeze protection, water flow switch			
Refrigerant	Type		R410a			
	Charge	kg	3.9×2	4.8×2	6.5×2	8.5×2
Compressor	Type		scroll	scroll	scroll	scroll
	NO.		2	2	2	2
Evaporator	Heat Exchanger			Tube-in-Tube		
	Water In/Out Pipe Diameter	Inch	1	1	1-1/2	1-1/2
Condenser	Heat Exchanger			Aluminum fin-copper tube		
	Fan Motor Power Input	kW	0.4	0.4	0.6	0.6
Pump	Water Flow	L/s	0.92	1.20	1.45	2.22
		GPM	14.6	19.0	22.9	35.3
	Delivery Lift	m	22	24	25	27
	Power Input	W	750	750	1500	1500
Expansion vessel Tankage		L	8	8	8	8
Unit Dimension	Height	mm	1850/1960	1850/1960	1760/1870	1760/1870
	Width	mm	1460/1540	1460/1540	1750/1830	1750/1830
	Depth	mm	530/610	530/610	800/880	800/880
Net/Gross Weight		kg	370/375	390/395	450/455	470/475

Notes:

- 1.Cooling capacity is based on the following conditions: leaving chilling water temp. 7°C(44.5°F), entering chilling water temp.12°C(53.6°F), and outdoor air temp. 35°CDB(95°F DB)
- 2.Heating capacity is based on the following conditions: leaving heating water temp. 45°C(113°F), entering heating water temp.40°C(104°F), and outdoor air temp. 7°CDB(44.6°F DB)
- 3.Water flow range for operation must be from 70% to 120% of the rated water flow.
- 4.The maximum allowable pressure for water pipe is 0.9MPa.
- 5.The delivery lift value showing in the table above equals to the difference between the delivery lift of the pump and the lose water pressure of the unit.

5 PERFORMANCE CORRECTION

5.1. Correction of Temperature

1) Cooling Capacity Correction

Leaving Chilling Water °C (°F)	Performance correction				
	Ambient Temperature °C (°F)				
	25(77)	30(86)	35(95)	40(104)	45(113)
5(41.0)	0.995	0.955	0.905	0.855	0.805
6(42.8)	1.045	1.005	0.955	0.905	0.855
7(44.6)	1.090	1.050	1.000	0.950	0.900
8(46.4)	1.145	1.102	1.052	1.000	0.950
9(48.2)	1.190	1.150	1.100	1.050	1.002
10(50.0)	1.245	1.200	1.150	1.100	1.050
11(51.8)	1.290	1.250	1.202	1.152	1.102
12(53.6)	1.340	1.300	1.252	1.200	1.152
13(55.4)	1.390	1.350	1.302	1.252	1.202
14(57.2)	1.442	1.402	1.350	1.302	1.252
15(59.0)	1.490	1.450	1.400	1.350	1.302

Calculation of actual cooling capacity:

Actual cooling capacity = nominal cooling capacity × cooling capacity correction coefficient

2) Heating Capacity Correction

Leaving Heating Water °C (°F)	Performance correction						
	-15(5)	-10(14)	-5(23)	0(32)	5(41.0)	10(50.0)	15(59.0)
30(86)	0.81	0.91	1.00	1.10	1.18	1.26	1.35
35(95)	0.74	0.84	0.93	1.03	1.11	1.19	1.28
40(104)	0.67	0.77	0.87	0.96	1.04	1.12	1.20
45(113)	0.60	0.70	0.80	0.89	0.97	1.05	1.13
50(122)	0.53	0.63	0.73	0.82	0.90	0.98	1.06
55 (131)	0.46	0.56	0.66	0.74	0.83	0.90	0.98

Calculation of actual heating capacity:

Actual heating capacity = nominal heating capacity × heating capacity correction coefficient

5.2 Correction of Connection Piping (For split type)

1) Connection Piping

Model	Diameter of Piping				The Max. Length	The Max. Fall	Replenishment Charge of Refrigerant (g/m)			
	Liquid		Gas							
	mm	inch	mm	inch						
HLR8WZNa-M	Φ12	1/2	Φ19	3/4	20	15	118			
HLR10WZNa-M	Φ12	1/2	Φ19	3/4	20	15	118			
HLR12.5WZNa-M	Φ12	1/2	Φ19	3/4	20	15	118			
HLR15WZNa-M	Φ12	1/2	Φ19	3/4	20	15	118			

2) Correction Value

Total Piping Length (Actual Length)		Correction Factor							
		5m	10m	15m	20m	25m	30m	35m	
Height difference between The Indoor and Outdoor Unit	The Indoor Unit Below The Outdoor Unit	0m	1.0	0.98	0.96	0.94	0.92	0.9	0.88
		5m	1.0	0.97	0.95	0.93	0.91	0.89	0.87
		10m	-	0.96	0.94	0.92	0.90	0.88	0.86
		15m	-	-	0.93	0.91	0.89	0.87	0.85
		20m	-	-	-	0.90	0.88	0.86	0.84
		25m	-	-	-	-	0.87	0.85	0.83
	The Outdoor Unit Below The Indoor Unit	0m	1.0	0.98	0.96	0.94	0.92	0.9	0.88
		5m	1.0	0.98	0.96	0.94	0.92	0.9	0.88
		10m	-	0.98	0.96	0.94	0.92	0.9	0.88
		15m	-	-	0.96	0.94	0.92	0.9	0.88
		20m	-	-	-	0.94	0.92	0.9	0.88
		25m	-	-	-	-	0.92	0.9	0.88

6 ANTIFREEZE

For heat pump unit, antifreeze fluid must be added to the water system. For cooling unit that will not be used in winter, the water inside the unit and pipe must be thoroughly drained to avoid freezing the tube-in-tube heat exchanger, pipe and water pump. If the water cannot be thoroughly drained out of the pipe, antifreeze fluid must be added. Do not cut off the power supply after the unit is stopped, otherwise the auto antifreeze protection will be disabled.

Ethylene glycol solution causes a variation in unit performance. To obtain the effective performance. It is necessary to multiply the water performance data by correction factors corresponding to the ambient temperature or Ethylene glycol percentage indicated in the following table.

% by Weight	0	12	22	30	36	41	46	50
Freezing Point°C (°F)	0(32)	-5(23)	-10(14)	-15(5)	-20(-4)	-25(-13)	-30(-22)	-35(-31)
Ambient Temperature°C (°F)	8.3(47)	3.3(38)	-1.7(29)	-6.7(20)	-11.7(11)	-16.7(2)	-21.7(-7)	-26.7(-16)
Cooling Capacity Correction Factor	1.0	0.985	0.980	0.974	0.970	0.965	0.964	0.960
Water Flow Correction Factor	1.0	1.02	1.04	1.075	1.11	1.14	1.17	1.20
Pressure Drop Correction Factor	1.0	1.07	1.11	1.18	1.22	1.24	1.27	1.30

7 ELECTRICAL DATA

7.1 split Type

Model	Rated Power Supply (Ph, V, Hz)	Compressor			Fan Motor		Pump	Total	
		NO.	LRA each (A)	MRC each (A)	Outdoor	MRC (A)		MRC (A)	NRC (A)
HLR8WZNa-M		1	67	9.1	1	1.5	0.7	9.4	7
HLR10WZNa-M	3, 380~415, 50	1	66	11.6	2	2	0.7	13.0	8.5
HLR12.5WZNa-M		1	67	13.7	3	2	0.7	14.5	10.5
HLR15WZNa-M		1	67	13.7	3	2	0.7	14.5	10.5

7.2 Integral Type


Model	Rated Power Supply (Ph, V, Hz)	Compressor			Fan Motor		Pump	Total	
		NO.	LRA each (A)	MRC each (A)	Outdoor	MRC (A)		MRC (A)	NRC (A)
HLR19SNa-M	3, 380~415, 50	2	66	11.6	2	5	1.5	19.5	14.5
HLR25SNa-M		2	80	13.5	2	5	1.5	23.5	18.5
HLR35SNa-M		2	101	16.4	2	7.5	3	28.5	24.5
HLR45SNa-M		2	125	22.5	2	7.5	3	45	31

Notes:

LRA: Locked rotor amps (A)
 MRC: Maximum running current (A)
 NRC: Nominal running current (A)


8 FIELD WIRING DIAGRAM

Split Type

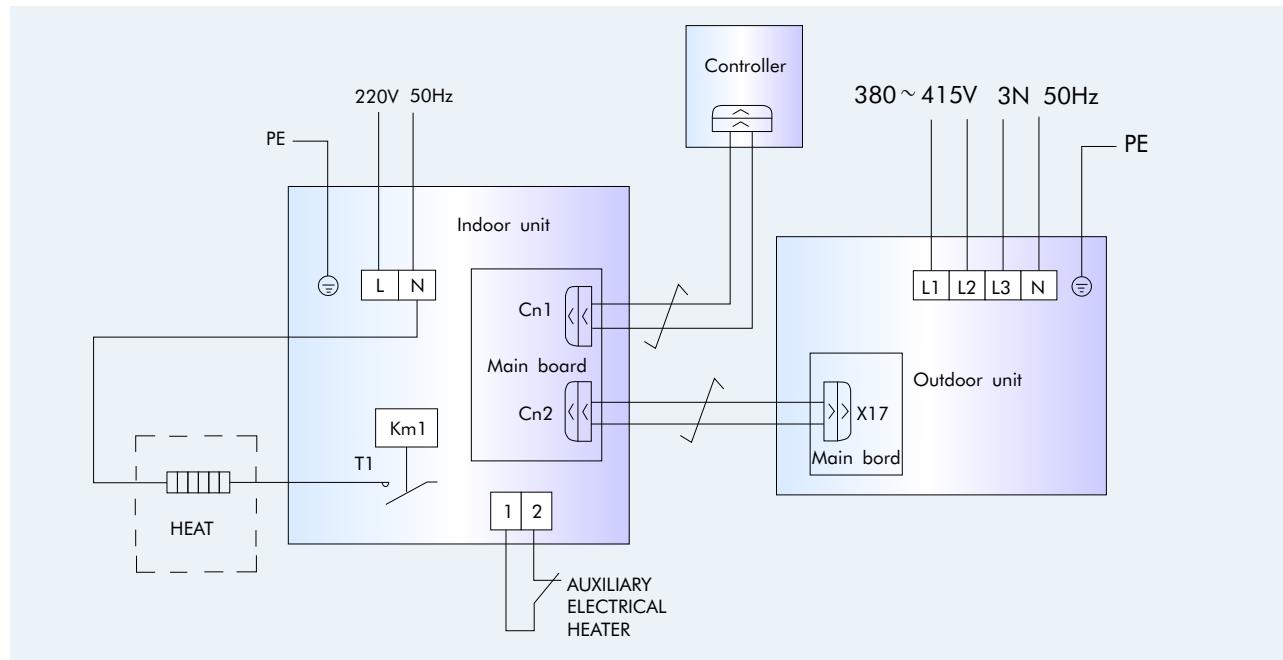


Integral Type

◆ HLR19SNa-M HLR25SNa-M

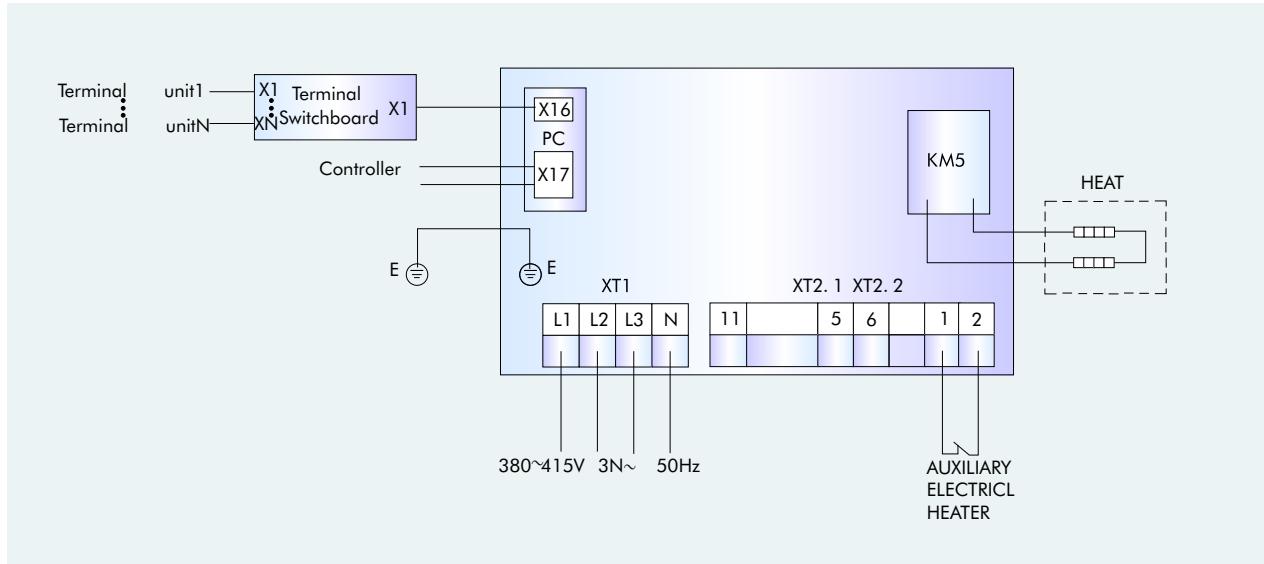


◆ HLR35SNa-M HLR45SNa-M

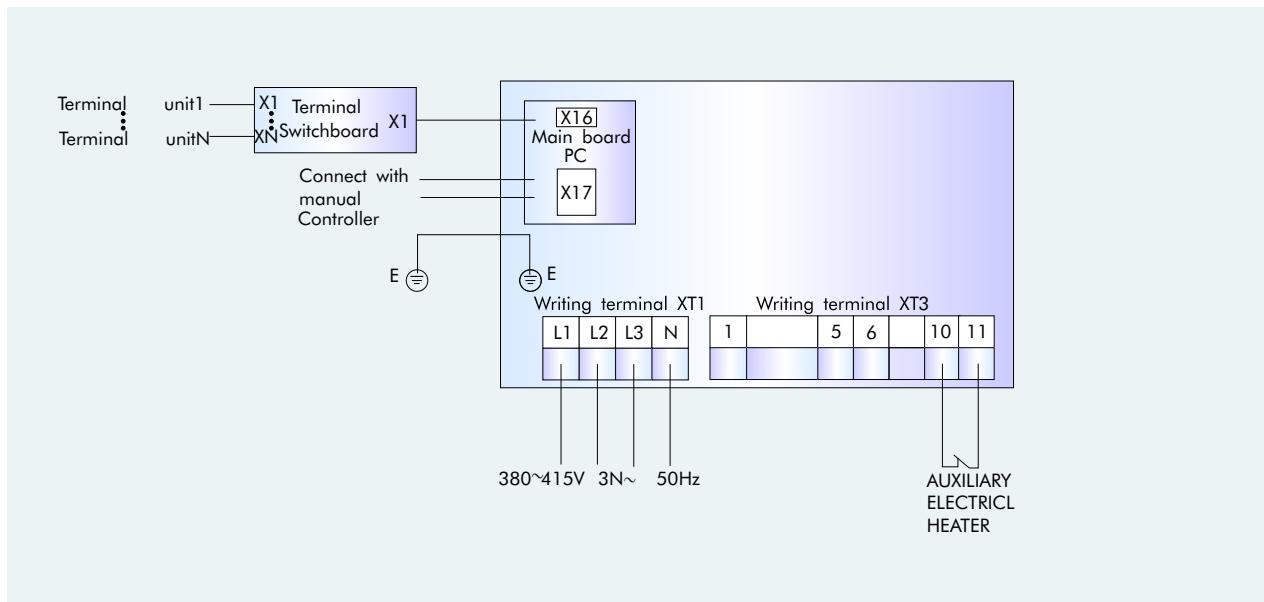


9 WIRING DIAGRAM

◆ HLR19SNa-M HLR25SNa-M

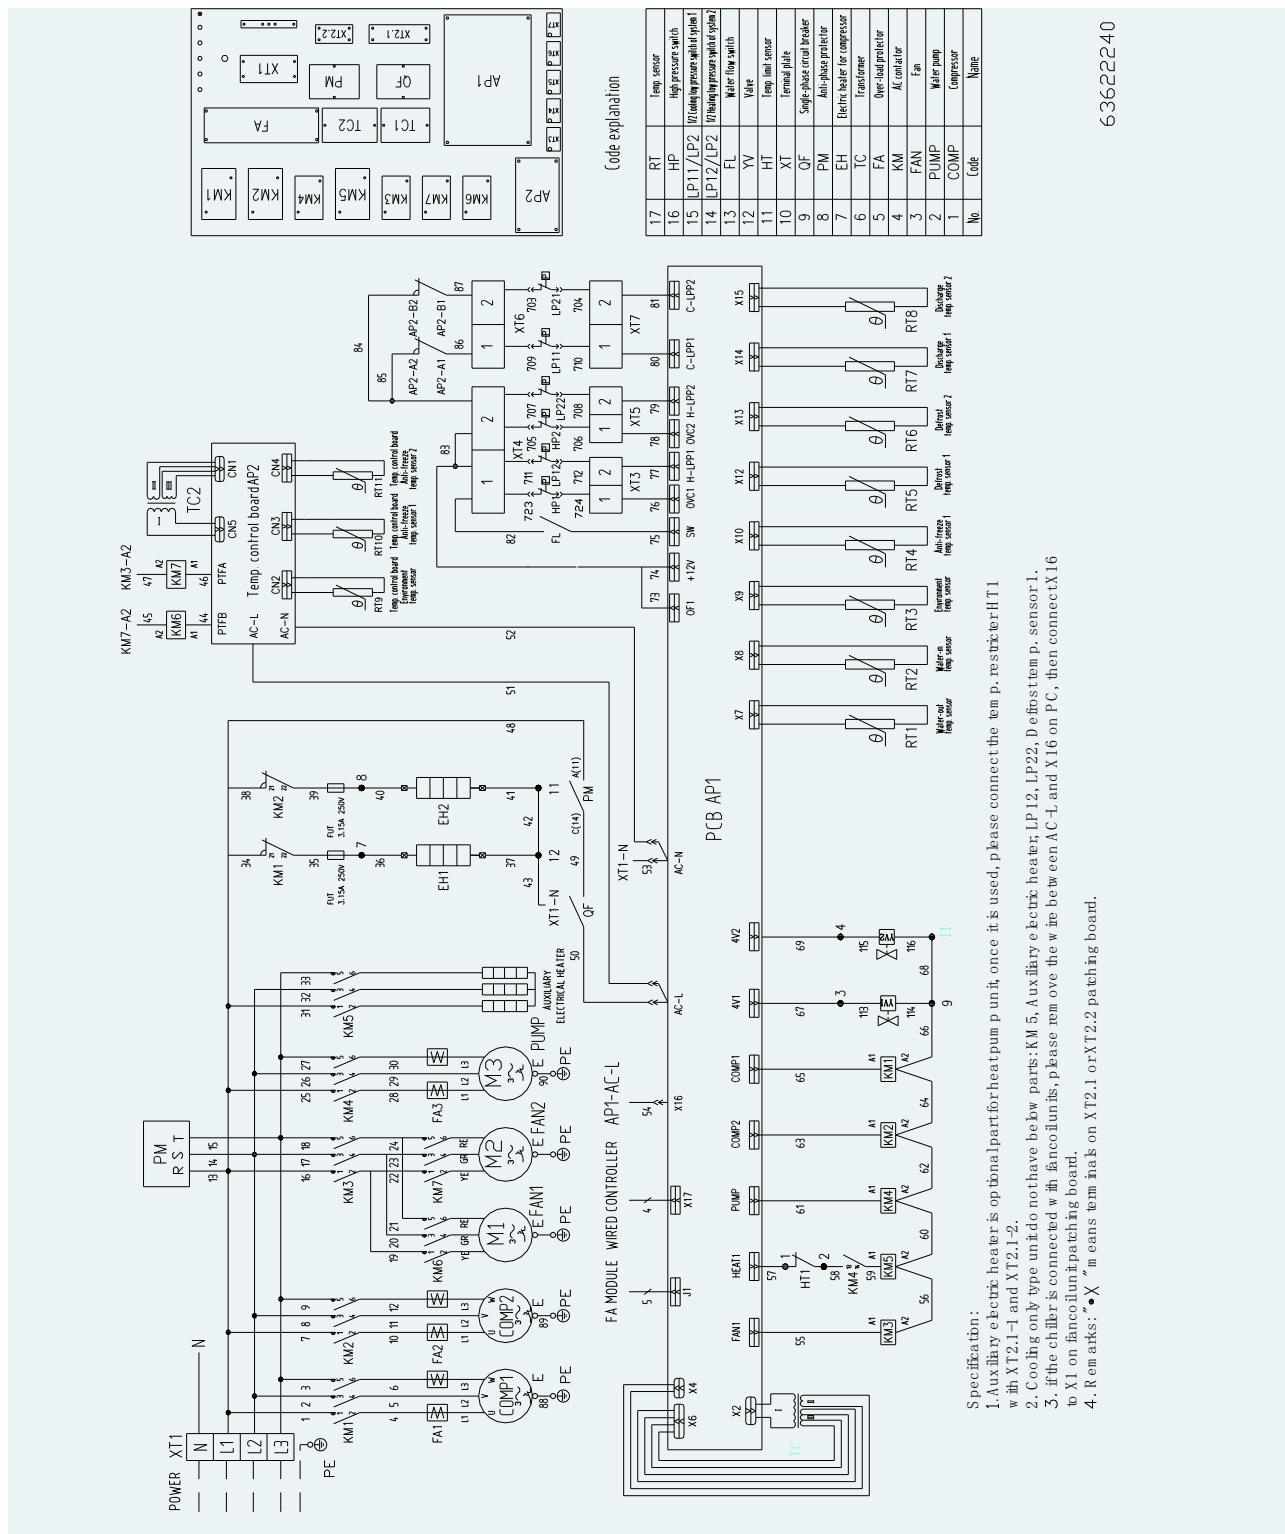

◆ HLR35SNa-M HLR45SNa-M

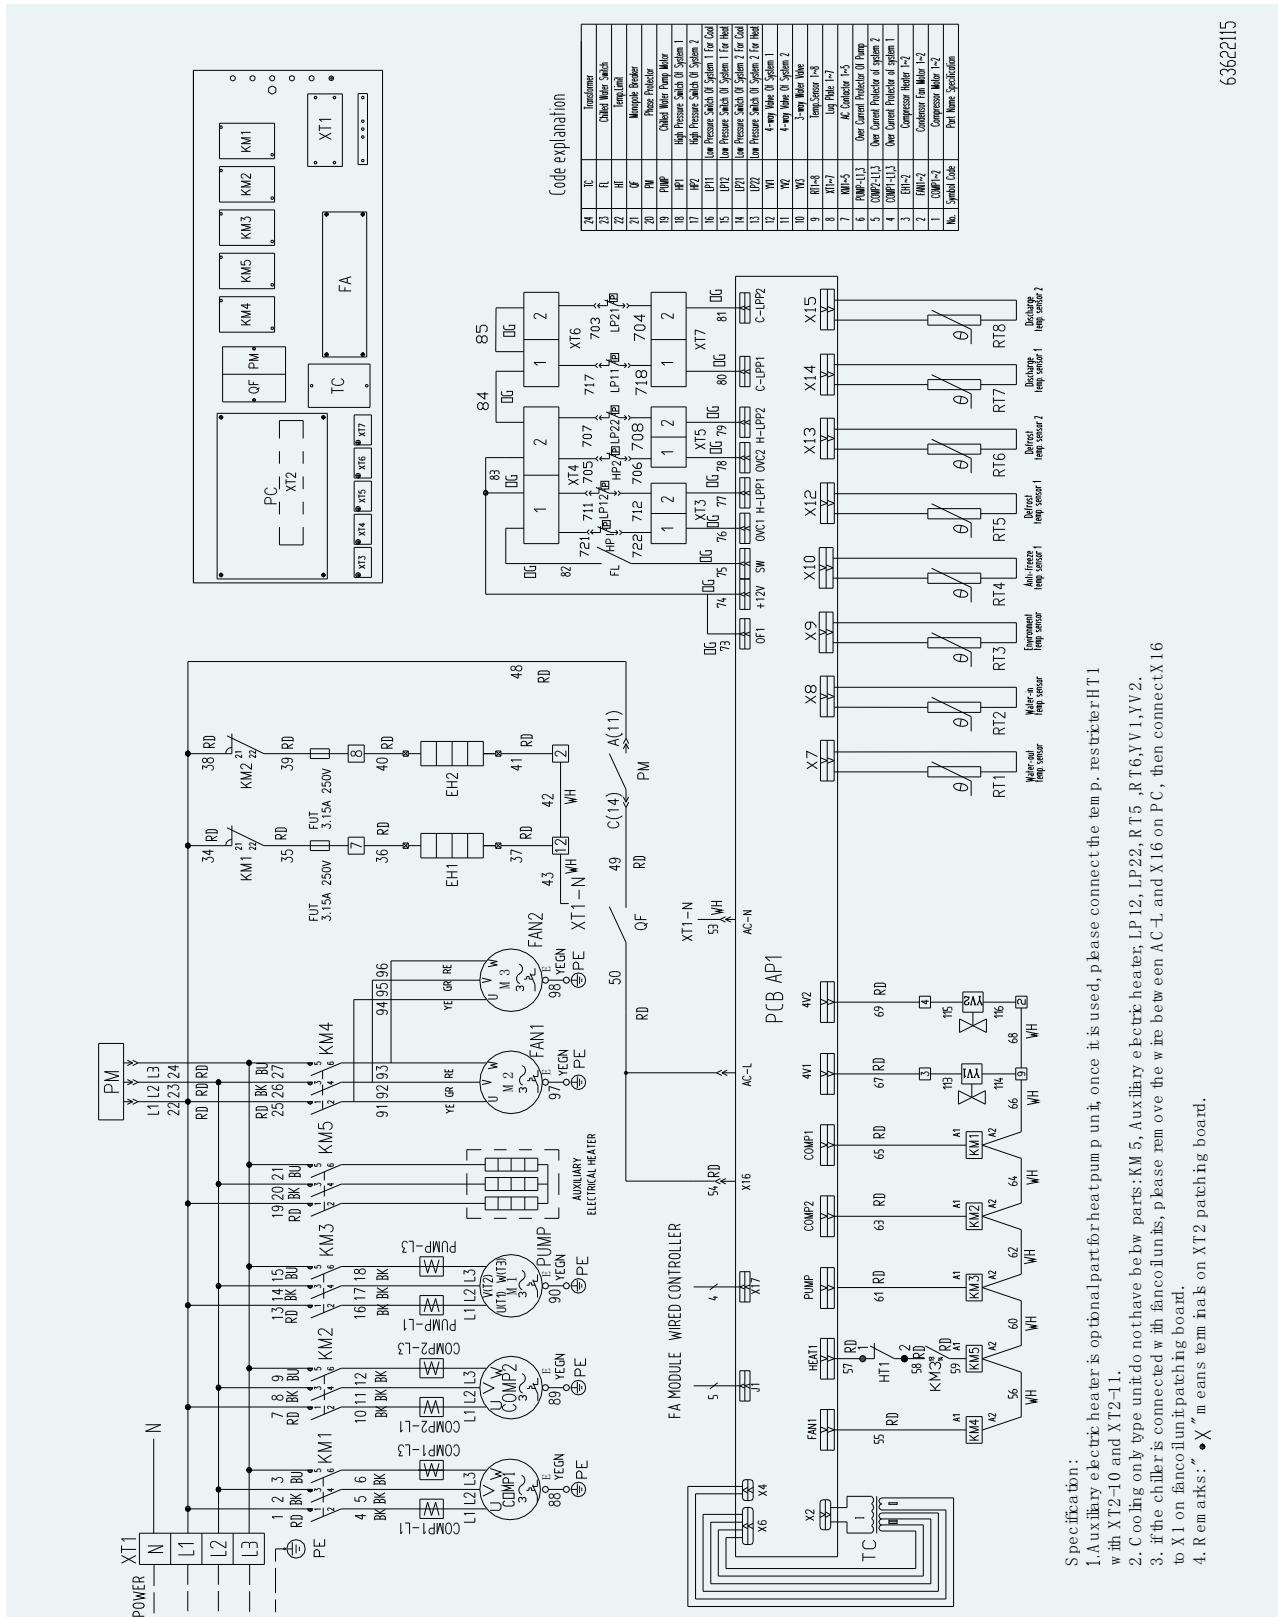

Specification:

4. Remarks: "X" means terminals on XT2 patching board.
Auxiliary electric heater is optional part for heat pump unit, once it is used, please connect the terminals, restricter IT1 with XT2-10 and XT2-11.
Cooling only type unit do not have below parts: KM5, Auxiliary electric heater, LP12, LP22, RT5, RT6, YV1, YV2.
If the chiller is connected with fan coil units, please remove the wire between AC-L and X16 on PC, then connect X16 to X1 on fan coil unit patching board.

10 INSTALLATION

→ 10.1 Location of Installation


1. The Mini Chiller unit can be installed on roof, ceiling, special flat or other place that is easy for installation and be able to stand its weight.
2. Select a place with well ventilation and smooth exhausting, and the place will not produce short-circuit circulation, and where exhausted air from the unit will not bother neighbors.
3. When placing the unit at roof, pay attention to wind direction to prevent direct up wind; when placing it on ground, avoid placing it at where there is strong wind.
4. There should be no heat source, exhaust vent of other facilities, strong steam and flammable gas around the unit.
5. When installing several units, ensure there is enough suction space to prevent short-circuit circulation.
6. Place where there is no large snow in winter.
7. There should be no obstruction near air intake vent or air outlet vent.
8. Place where with drainage pipe around the unit to drain cooling or heating water.
9. Place where near power for easy wiring.
10. Place where near supply water source for convenient pipe construction.
11. There should be open space around the unit.

→ 10.2 Unit Dimension


10.2.1 Split Type

1) Outdoor Unit


◆ HLR8WZNa-M(O)

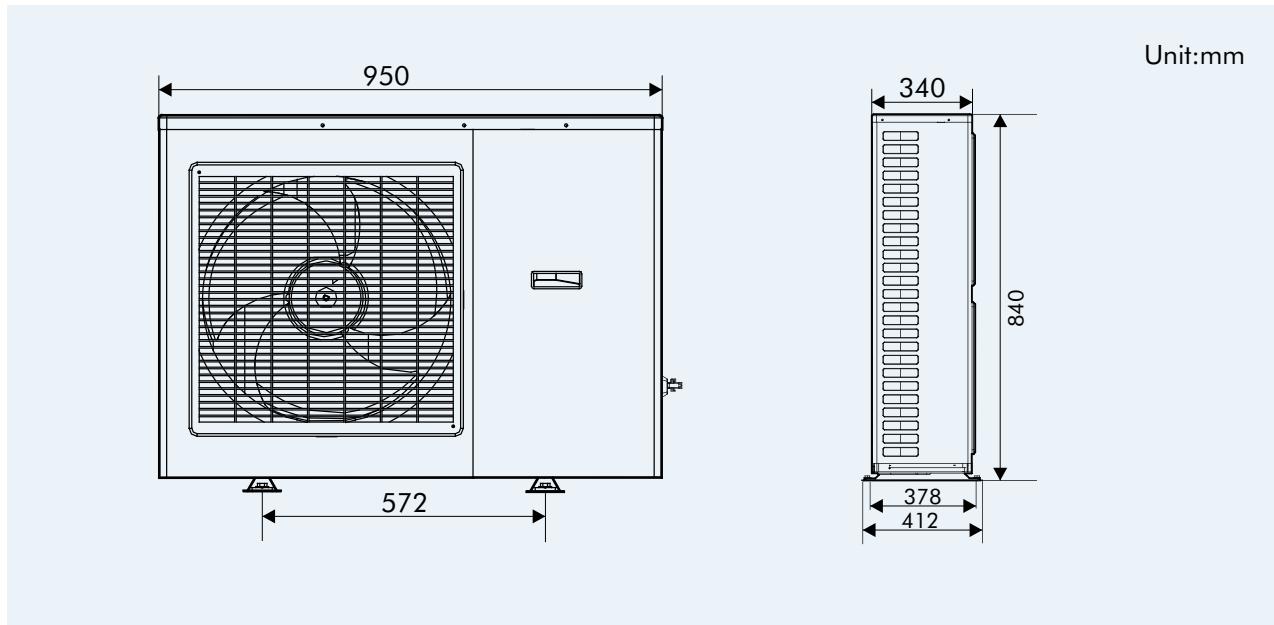

◆ HLR10WZN_A-M(O)、HLR12.5WZN_A-M(O)、HLR15WZN_A-M(O)

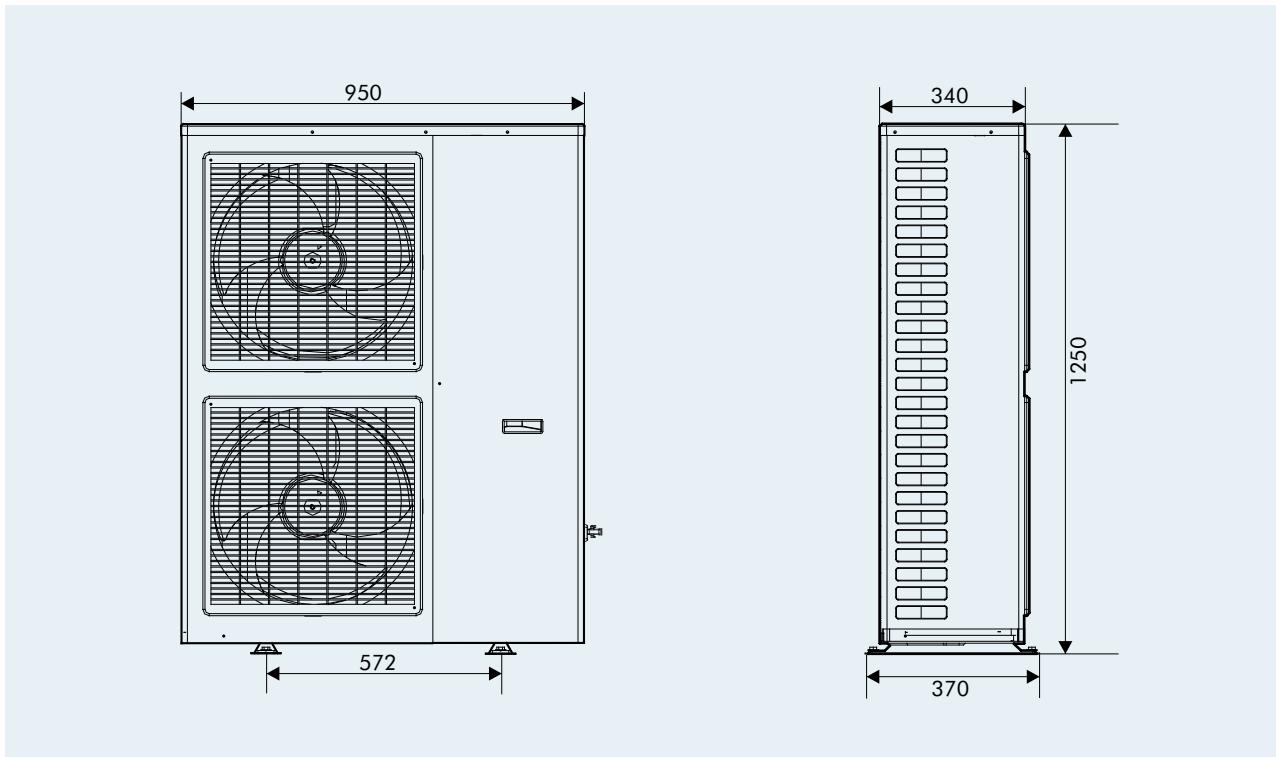


2) Indoor Unit

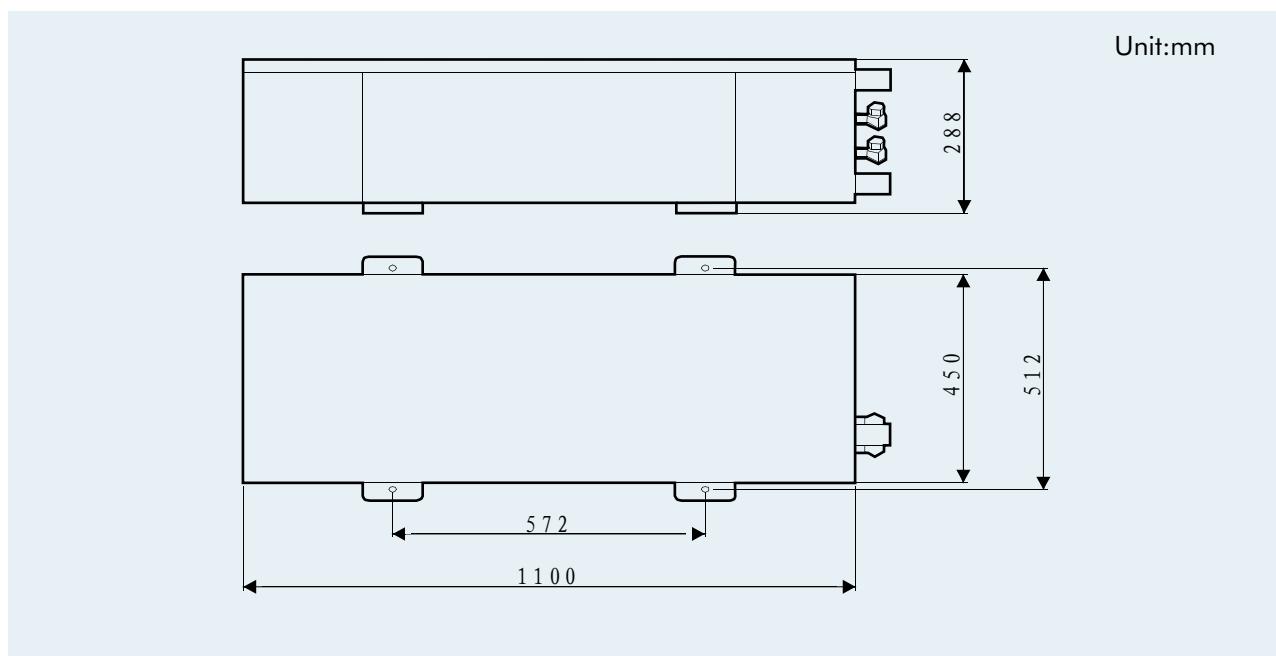


10.2.2 Integral Type


◆ HLR19SNa-M、HLR25SNa-M

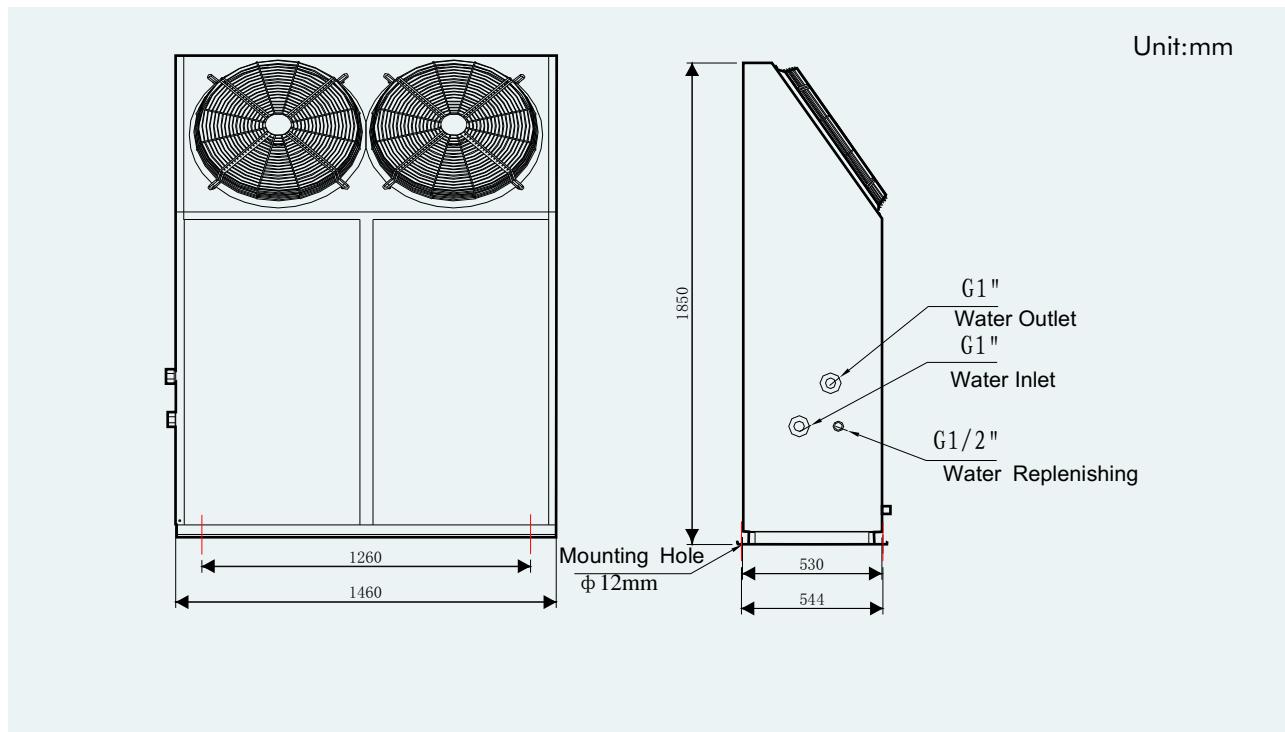


◆ HLR35SNa-M、HLR45SNa-M

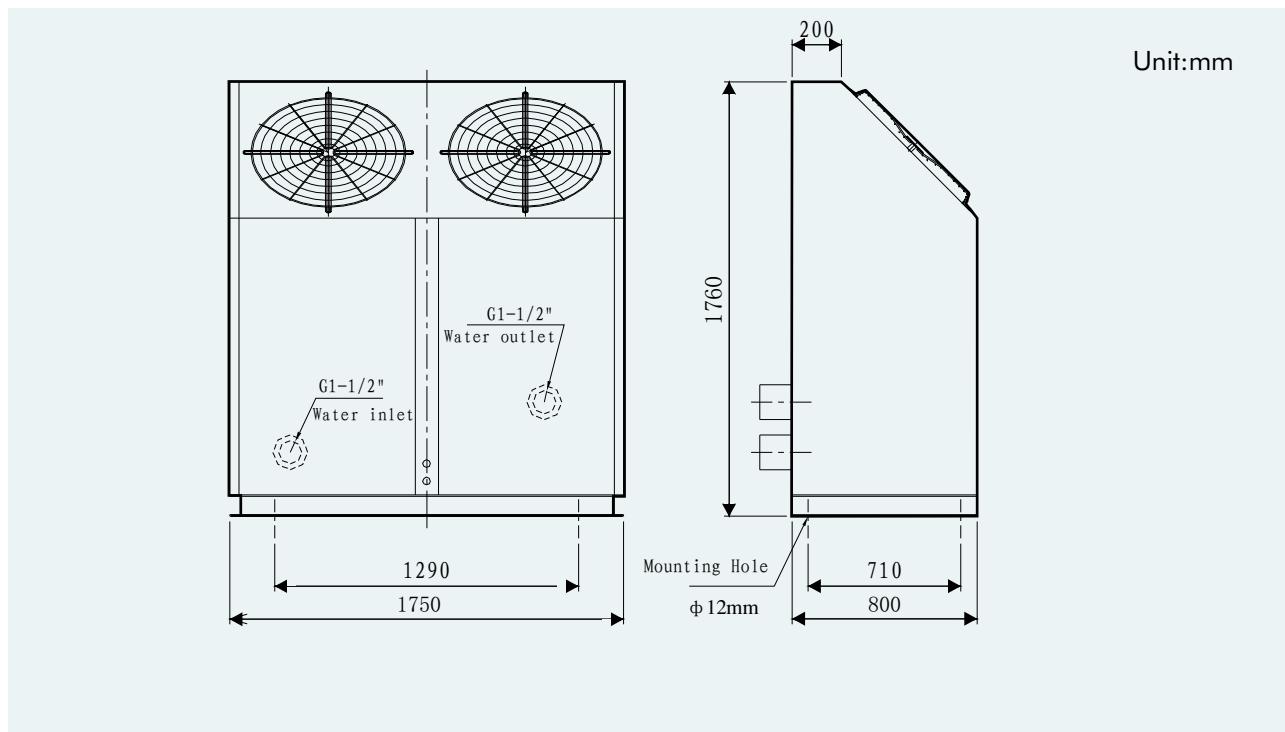

10.2.3 Wired Controller

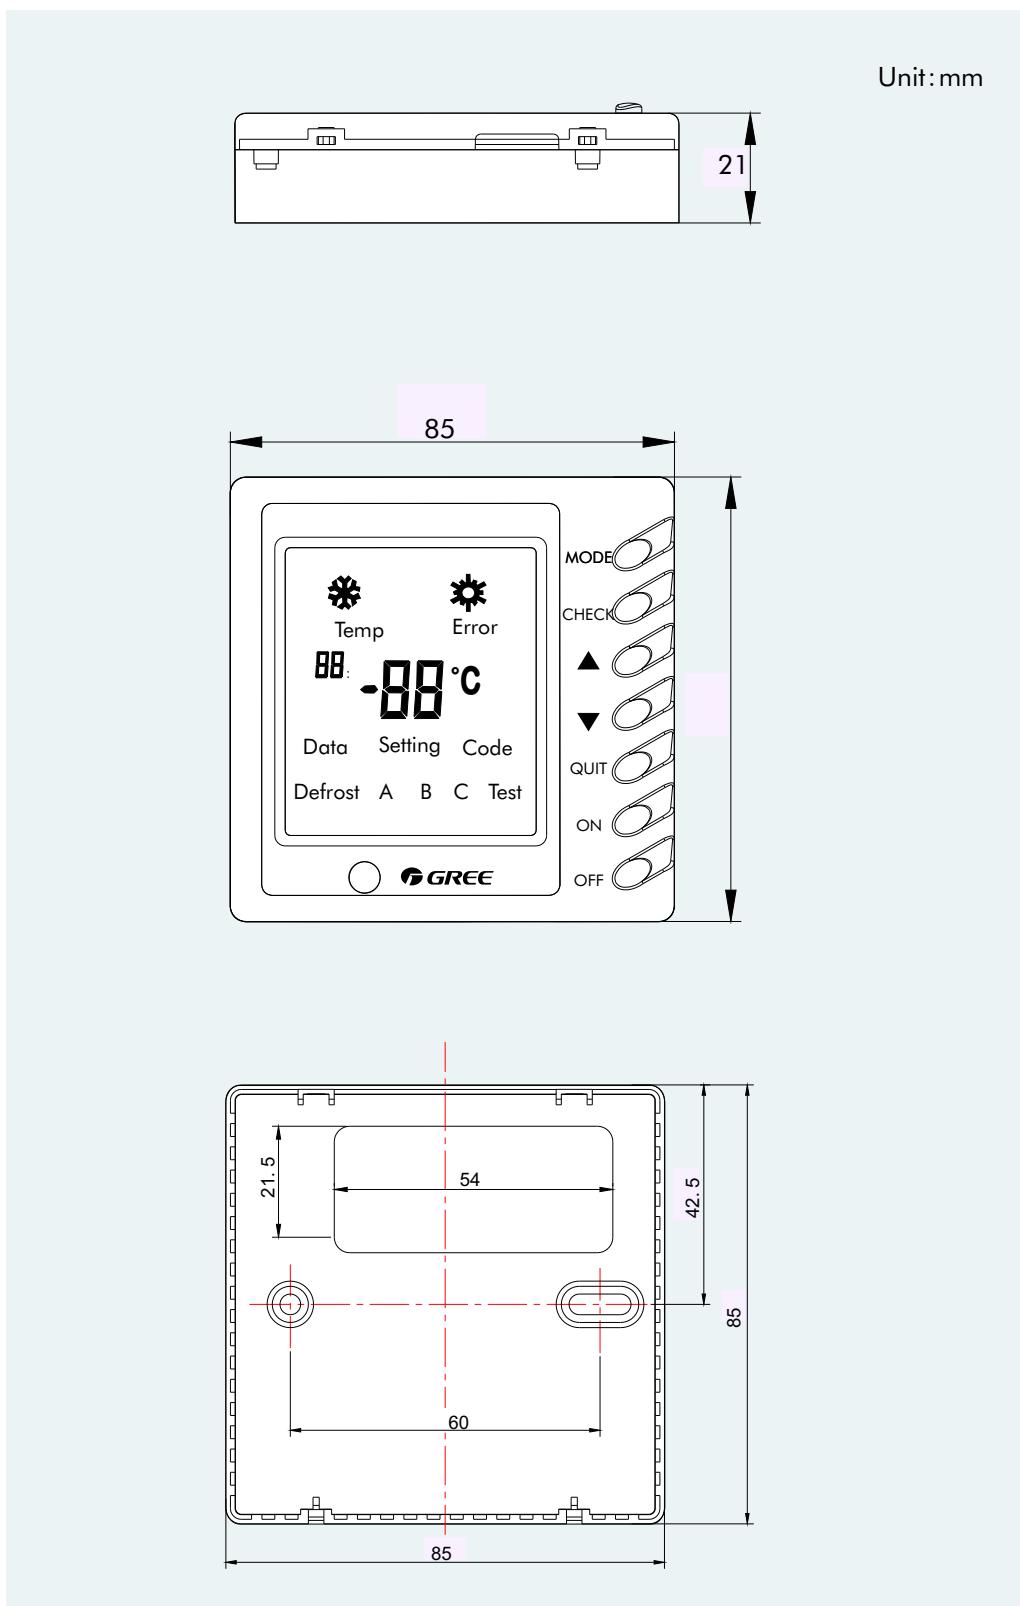

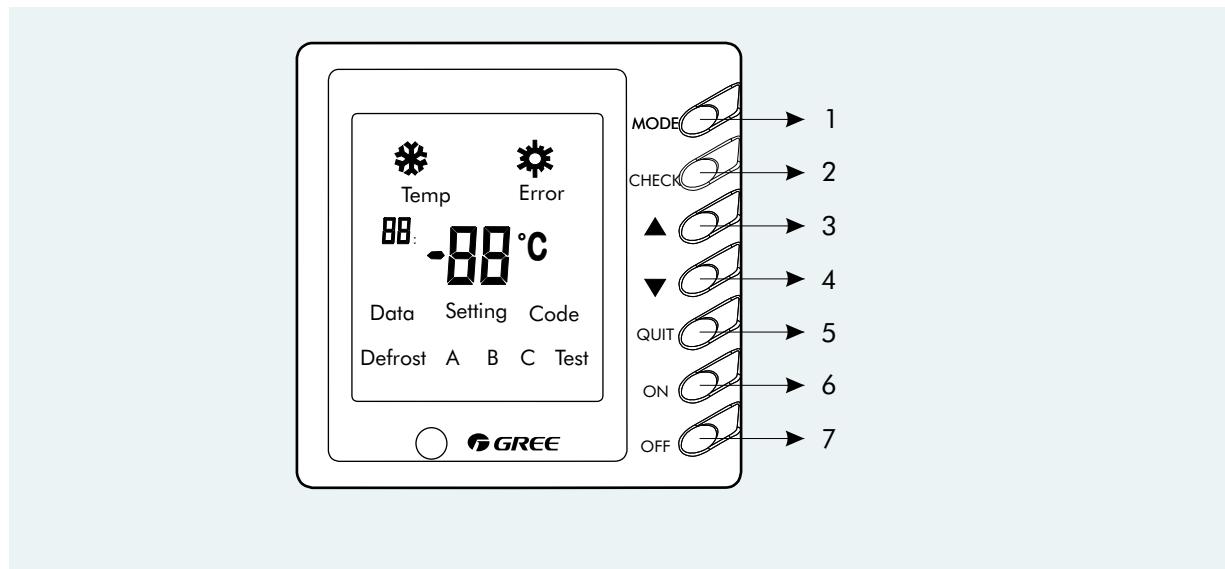


NO.	Key Name	Function description
1	MODE	It can switch between cooling and heating, this button is available only on cooling and heating unit.
2	CHECK	Press it once under normal state to enter check mode, under check mode, press this button when "17" is displayed can change the value of "17". Under parameter set mode, press this once can switch the adjusting objection between parameter and value, press this button for long (about 5s) to save and quit this parameter setting.
3	▲	To increase present set value or change set/check object.
4	▼	To decrease present set value or change set/check object.
5	QUIT	Under Set and Check mode, press it once to quit this mode. Under parameter set mode, this set value would not be saved. Press this button for long (about 5s) to set sound, and make sound switches between always on and always off.
6	ON	It is used to turn on the unit. Press the button for 1 second when unit is off to turn on the unit. This button cannot be pressed continuously.
7	OFF	It is used to turn off the unit. Press the button for 1 second when unit is on to turn off the unit. This button cannot be pressed continuously.

10.3 Installation Clearance

10.3.1 Split Type


1) Outdoor unit

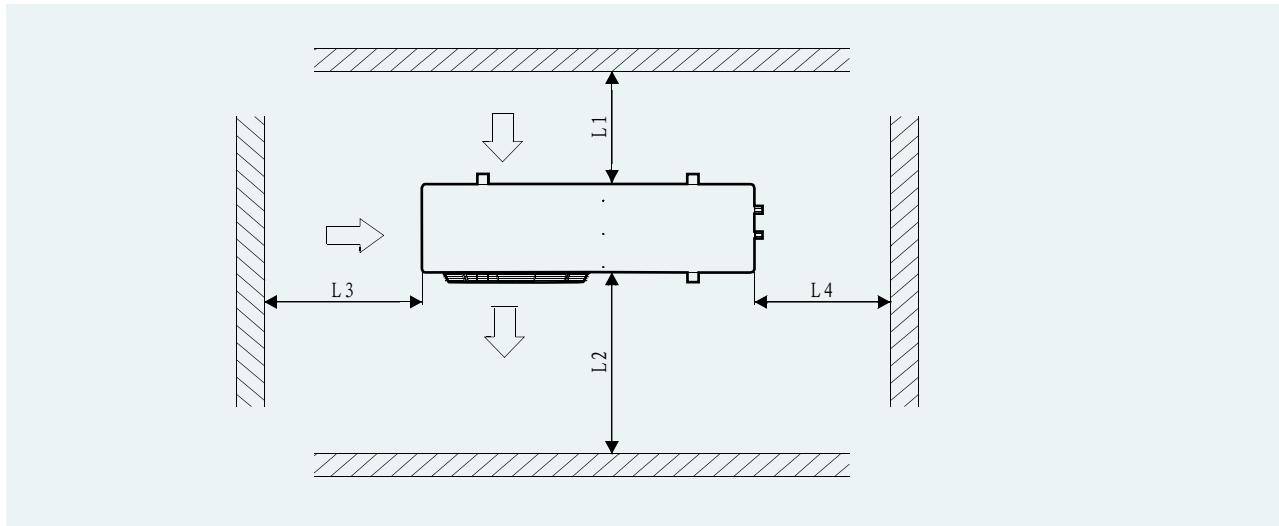

Unit:mm

Code	L1	L2	L3	L4
Spacing	>500	>1000	>500	>500


2) Indoor unit

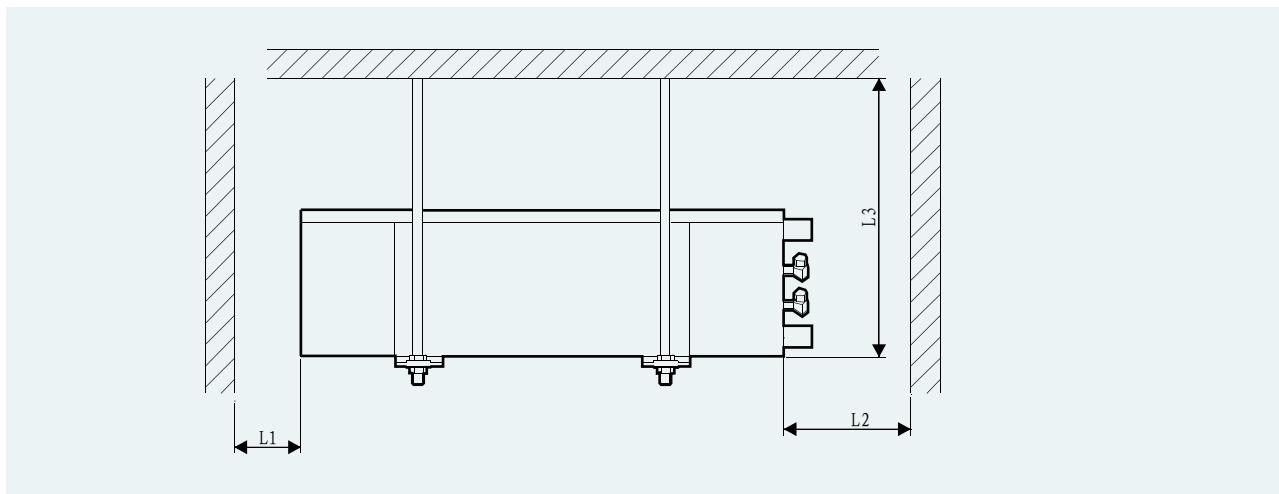

Unit:mm

Code	L1	L2	L3
Spacing	>250	>800	<1200

10.3.2 Integral Type

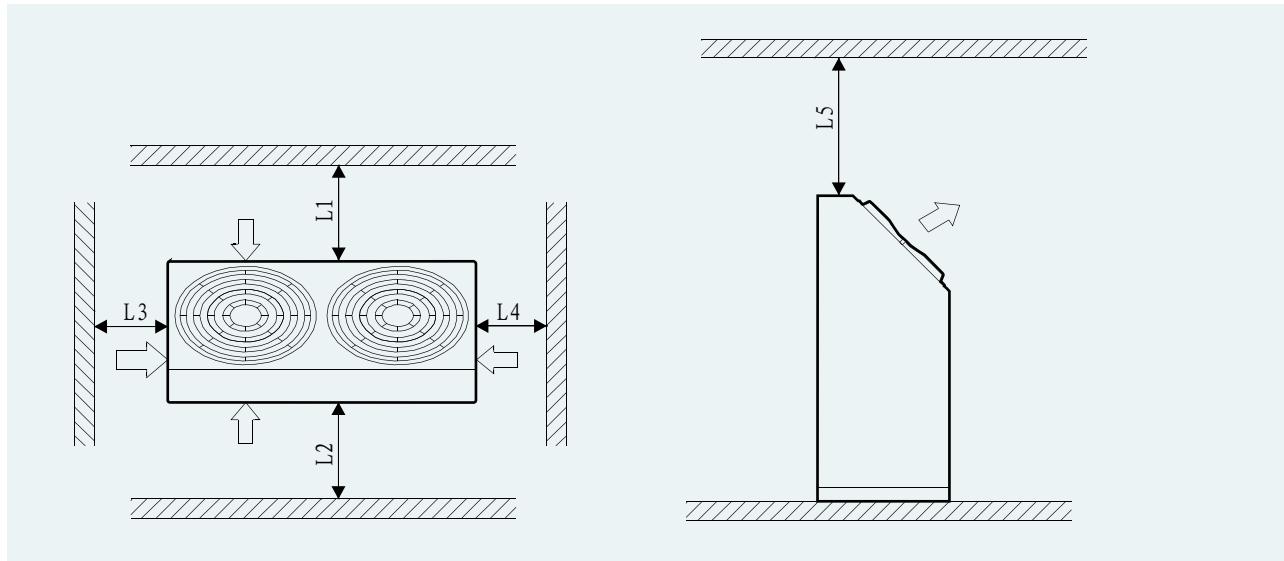


Unit:mm

Code	L1	L2	L3	L4	L5
Spacing	>1000	>1200	>1000	>1000	>2000

→ 10.4 Sketch Map of Installation of Water System


10.4.1 Split Type

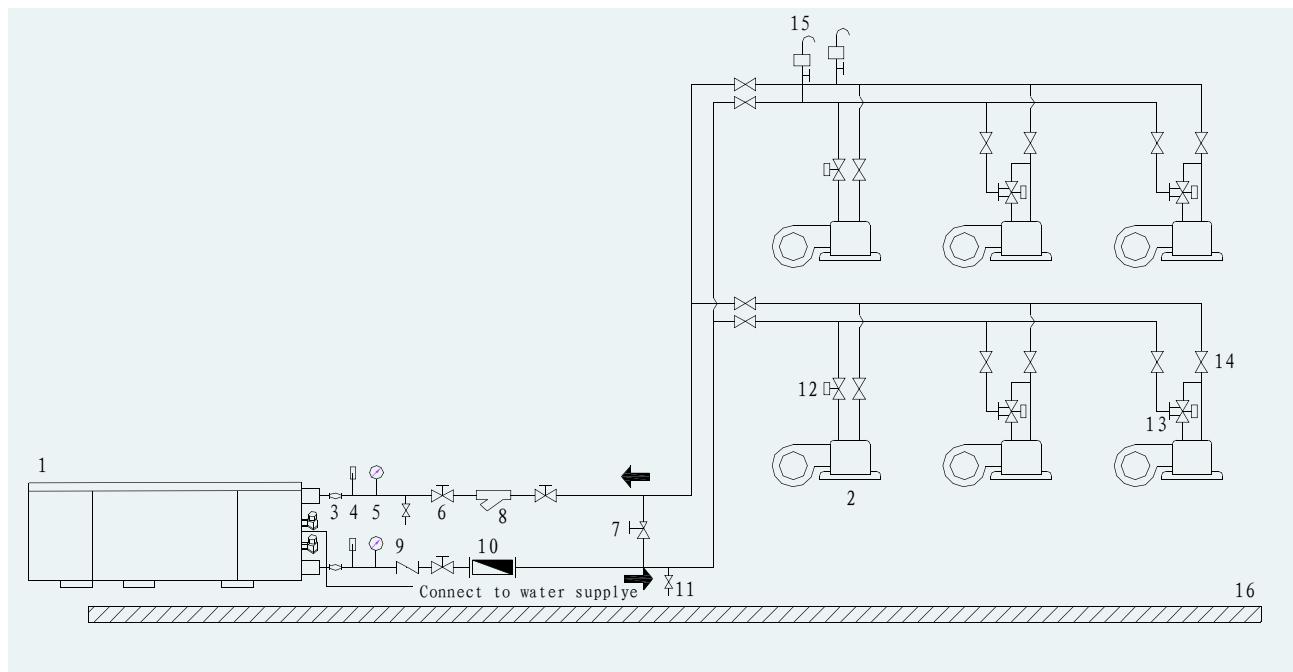

1	Host air conditioner	9	Check valve
2	Fan coil	10	Flowmeter
3	Rubber soft contact	11	Water drainage valve
4	Thermometer	12	Electric 2-way valve
5	Manometer	13	Electric 3-way valve
6	Cut-off valve	14	Ball valve
7	By-pass control valve	15	Auto exhaust valve
8	Y-type filter	16	Base


9.4.2 Integral Type

1) Open expansion water tank system

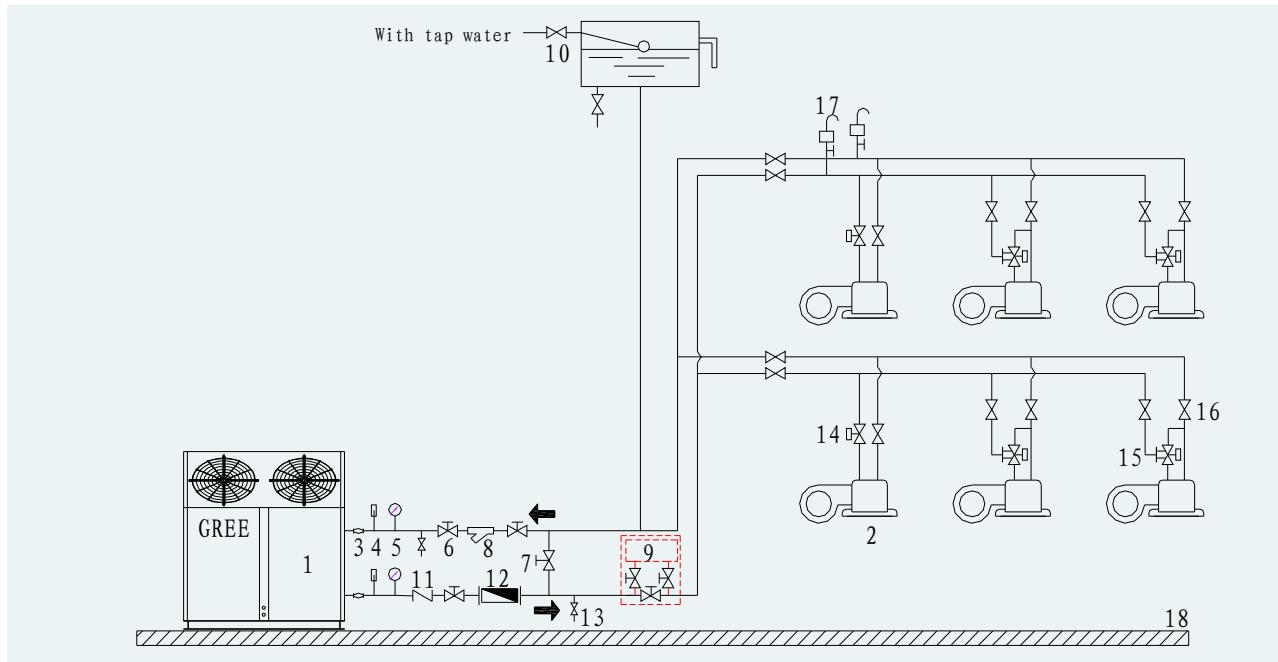

1	Host air conditioner	10	Float-ball water valve
2	Fan coil	11	Check valve
3	Rubber soft contact	12	Flowmeter
4	Thermometer	13	Water drainage valve
5	Manometer	14	Electric 2-way valve
6	Cut-off valve	15	Electric 3-way valve
7	By-pass control valve	16	Ball valve
8	Y-type filter	17	Auto exhaust valve
9	Auxiliary electric heater/hot-water boiler	18	Base

2) Closed expansion water tank system

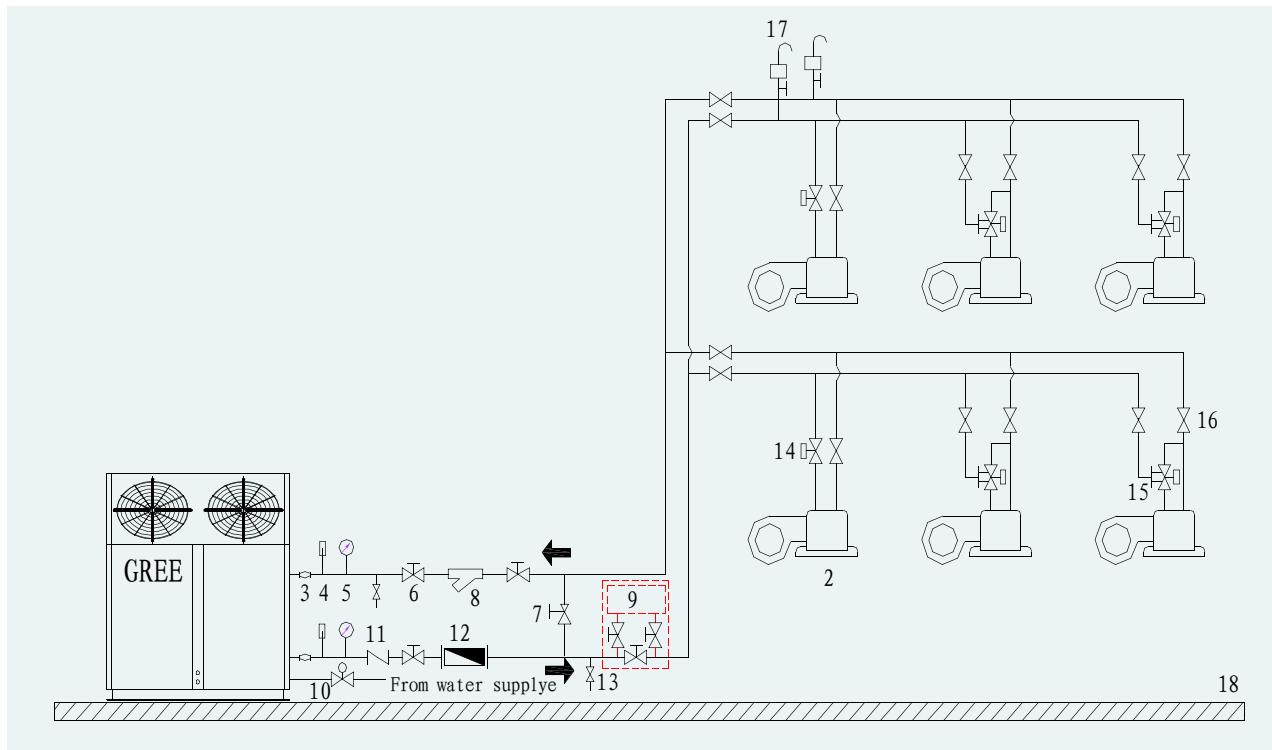

1	Host air conditioner	10	Auto water fill valve
2	Fan coil	11	Check valve
3	Rubber soft contact	12	Flowmeter
4	Thermometer	13	Water drainage valve
5	Manometer	14	Electric 2-way valve
6	Cut-off valve	15	Electric 3-way valve
7	By-pass control valve	16	Ball valve
8	Y-type filter	17	Auto exhaust valve
9	Auxiliary electric heater/hot-water boiler	18	Base

11 ACCESSORIES

Name	Standard	Optional	Provided by user
Auto water fill valve	✓	✗	✗
Safety valve	✓	✗	✗
Auto exhaust valve	✓	✗	✗
Wire controller	✓	✗	✗
water pump	✓	✗	✗



making better air conditioners



Gree Electric Appliances, Inc. of Zhuhai ("Gree") is the largest specialized air conditioner enterprise in the world.

Gree has now become a renowned multinational enterprise that possessing 4 production bases located in Zhuhai, Chongqing, Brazil and Hefei, and five subsidiary companies, totally 37,800 employees. Annual production capacity of us is over 25 million sets of home air conditioners and annual output value of 716 million USD from commercial air conditioners.

We are always paying much attention on technical innovation. Till now, we had registered nearly 1500 patents at home or abroad. The high-end technologies we have successfully developed include the GMV multi VRF system, centrifugal chiller and, in particular, central air conditioners using ultra-low temperature heat pump, which is the first of its kind in the world and an internationally-advanced technology that has filled in a gap of China and broken the technical monopoly of the refrigeration magnates in the United States and Japan, winning widespread reputation and influence in the world refrigeration industry.

With the installation of Gree commercial air conditioners in important projects at home and abroad like Media Village for 2008 Beijing Olympic Game, Stadiums for 2010 World Cup in South Africa, as well as Indian Telecom base station, Gree commercial air conditioners are ready to develop steadily to every corner in the world, to present a more comfortable and harmony working environment and family atmosphere.



GREE ELECTRIC APPLIANCES ,INC.OF ZHUHAI

Add:West Jinji Rd.,Qianshan,Zhuhai,Guangdong,China 519070

Tel:(+86-756)8614883 Fax:(+86-756)8614998

[Http://www.gree.com.cn](http://www.gree.com.cn) Email:gree@gree.com.cn

For continuous improvement in the products, Gree reserves the right to modify the product specification and appearance in this manual without notice and without incurring any obligations.

SN00300039